

Aotoro®

TP Flat type 平面安装型

INSTRUCTION MANUAL

使用说明书

PROXIMITY SWITCH
接近开关



A2302-04

Model selectable 型号选择

Appearance 外形	Detecting distance 探测距离	OUTPUT	Model型号
	5mm	NPN NO	TP18-5DN
		NPN NC	TP18-5DN2
		PNP NO	TP18-5DP
		PNP NC	TP18-5DP2
	15mm	NPN NO+NC	TP40-15DN3
		PNP NO+NC	TP40-15DP3
		NO(AC type)	TP40-15AO
		NC(AC type)	TP40-15AC

Appearance 外形	Detecting distance 探测距离	OUTPUT	Model型号
	40mm adjustment 可调节	NPN NO+NC	TP80-40DN3
		PNP NO+NC	TP80-40DP3
	70mm adjustment 可调节	NPN NO+NC	TP140-70DN3
		PNP NO+NC	TP140-70DP3

Specification 规格

Model 型号	TP18-5DN TP18-5DN2 TP18-5DP TP18-5DP2	TP40-15DN3 TP40-15DP3 TP40-15AO TP40-15AC	TP80-40DN3 TP80-40DP3	TP140-70DN3 TP140-70DP3
Detecting distance 探测距离	5mm	15mm	40mm可调节	70mm可调节
Setting distance 设定距离	0 to 3.5mm	0 to 10.5mm	0 to 28mm	0 to 49mm
Standard Detecting target 标准探测体	Iron 18x18x1mm(铁)	Iron 40x40x1mm(铁)	Iron 80x80x1mm(铁)	Iron 140x140x1mm(铁)
Hysteresis 回差	Max. 10% of detecting distance (检测距离的10%以下)			
Power supply 电源电压	DC type: 12-24VDC(10-30VDC) AC type: 90-250VAC			
Current consumption 静态电流	DC type: Max. 10mA AC type: Max. 2.2mA			
Response frequency 频率	300HZ	DC: 100HZ AC: 20HZ	50HZ	50HZ
Residual voltage 残留电压	DC type: Max. 1.5V AC type: Max. 10V			
Control output 控制输出	Max. 200mA			
Protection circuit 电路保护	Reverse polarity protection反极性保护, Surge absorber浪涌保护			
Insulation resistance 绝缘	Min. 50MΩ (500VDC)			
Dielectric strength 耐电压	1500VAC 50/60HZ for 1 minute			
Operating temperature 使用环境温度	-25 to +70°C (non-freezing condition 不结冰)			
Protection 保护结构	IP66 (IEC Specification)			


Ordering information 订购信息

TP18-5DN2


Output 输出构成	N	NPN NO 3-Wire
	N2	NPN NC 3-Wire
	P	PNP NO 3-Wire
	P2	PNP NC 3-Wire
	O	NO 2-Wire 二线
Supply 电压	C	NC 2-Wire 二线
	N3	NPN NO+NC
	P3	PNP NO+NC
Detecting distance 检测距离	D	DC Type
	A	AC Type
Serial number 设计序号	5	5mm
	15	15mm
	20	20mm
	40	40mm
	70	70mm
Appearance 外型分类	Side length 探测头边长(mm)	
	R	Cylindrical 圆柱型
	S	Rectangle 方型
	P	Flat 平面型
Proximity switch 接近开关	U	Groove shape 槽型
	T	Inductive 电感式
	C	Capacitive 电容式
	S	HALL 霍尔式

Dimensions 尺寸(unit:mm)


TP18




TP40

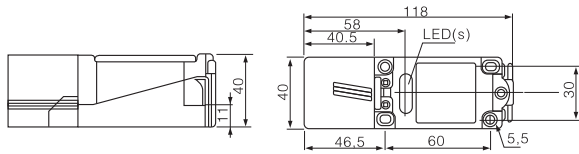

TP80


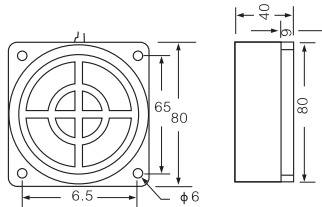


TP140


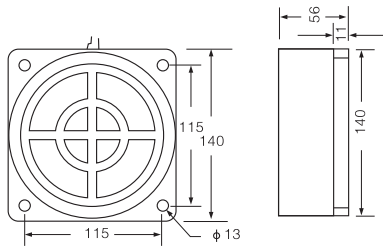


Control output diagram 控制输出图


DC 4-wire(四线型)NO+NC

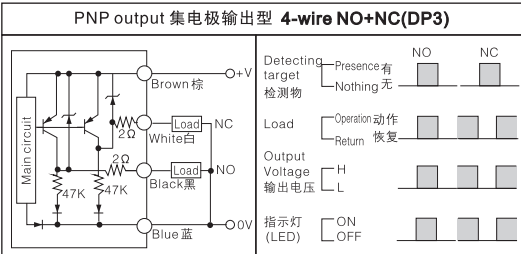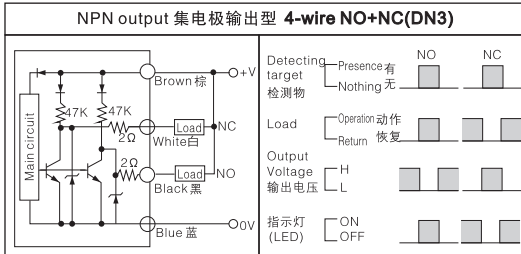


DC 3-wire(三线型)

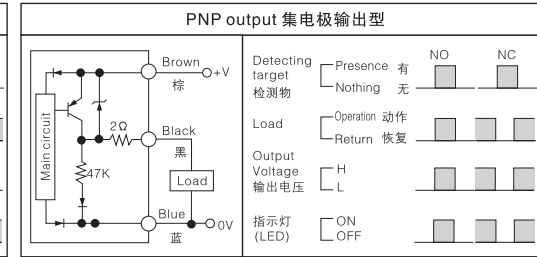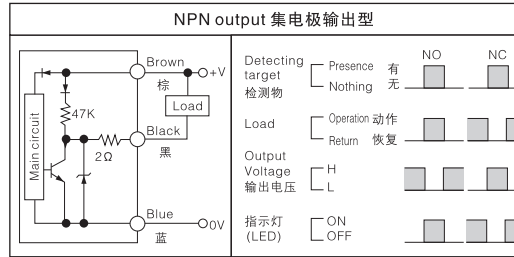

AC 2-wire(二线型)

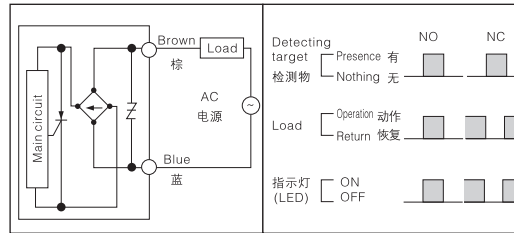

DC 2-wire(二线型)

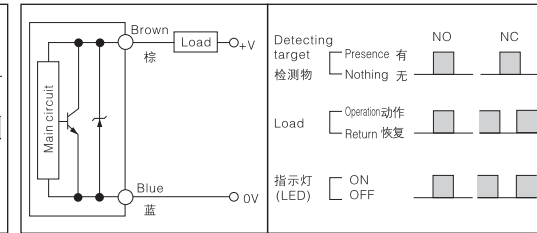

Precautions in using the product 使用注意事项

NOTE 注意

Be sure to follow the safety precautions below for adder safety

以下项目在安全确保方面非常重要,请务必遵守。

- Do not use the sensor under the explosive or flammable gas environment. 请不要在具有可燃性、爆炸性气体的环境下使用。
- Never disassemble, repair or tamper the product. 请勿拆卸、修理、改造本产品。
- Keep the supply voltage within the specified area. 电源电压必须在额定值内。
- use the load under the specified area. 请使用额定值以下的负荷。

Caution for using 正确使用方法

- Do not use the product under the following conditions. 请不要在以下的环境中使用。
 - In the place of the direct sunlight. 日光直射场所。
 - In the place where humidity is high and condensation may occur. 湿度高或易结露场所。
 - In the place of the corrosive gas exists. 含腐蚀性气体场所。
 - In the place where vibration or shock is directly transmitted to the product. 振动或冲击能直接传送到传感器场所。
- Connection and Mounting 连接和安装
 - Be sure that before giving the power, the supply voltage is less than the maximum rated supply voltage. 通电前请确认供电电源电压小于最大允许电源电压。
 - There are some cases where the sensors cable is unavoidably laid in a tube or duct together with a hightension or power line. This causes an induction, possibly resulting in malfunction or damage. In principal, the cable should be separately laid or shielded. 传感器导线和动力线或电力线装在同一配管中使用,会受到干扰,有误动作甚至被损坏。原则上传感器导线必须单独放置或者被屏蔽。
 - For extending wires, whose cross section is greater than 0.3sqmm and the length less than 100m. 延长导线必须使用截面积0.3mm²以上、长度100m以下导线。
 - Do not pull wire strongly. 导线请勿用力拉扯。
 - Excessive force (hitting by hammer, etc.) Should not be put on the sensors because it may damage its water-resistance. 安装传感器时,请勿使传感器受剧烈外力(如用锤击打等),这样就有可能破坏传感器防水保护性能。
- Power supply 电源

When using a commercially available switching regulator, be sure to ground the FG(Frame Ground) terminals. 使用市场上销售的开关整流器时,请将FG(Frame Ground)端子接地。
- Power supply reset time 电源重新调整时间


The sensors will begin sensing no later than 100ms after the power is turned on. If the load and the sensors connected to different power supply, the sensors must be always turned on first. 从接通电源到传感器可正常进行检出的时间是100ms后再使用。负载和传感器接不同电源时,一定要先接通传感器的电源

5. Turning off the power supply 电源关闭
When turning off the power, output pulse may be generated. We recommend turning off the power supply of the load or load line first. 电源关闭时,可能会出现输出脉冲,所以我们建议先关闭负载或负载线的电源

6. AC 2-wire type & DC 2-wire type

交流二线和直流二线型

- The load must be connected otherwise internal components may be damaged. And the load can be connected to tother wire. 接线时需将负载串接到其中任意一根连接线,否则传感器会短路爆裂。
- In case of the load current is small, connect the bleeder resistor to load parallel. as following picture shows: 如果负载电流过小: 负载的残余电压会使传感器失灵, 请确保残余电压要小于启动电压, 可以安装一个与负载并联的分流电阻, 如图所示:

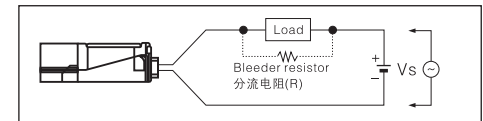

$R \leq \frac{V_s}{I_0 - I_{off}} (k\Omega)$
 $P > \frac{V_s^2}{R} (mW)$

V_s : power supply 电源
 P : Bleeder resistor, number of W 分流电阻功率
 I_0 : Min. operating current of proximity switch 接近开关的最小动作电流
 I_{off} : Return current of load 负载的恢复电流

※ 110VAC 50/60HZ, bleeder resistor over 20K, Min. 3W
 220VAC 50/60HZ, bleeder resistor over 39K, Min. 5W

浙江欧迪龙电子科技有限公司
Zhejiang Aotero Electronic Technology CO.,LTD
 ADD: Lihuang Road 2188#, Liushi town, Yueqing city, Zhejiang province. PRC 325604
 浙江省乐清市柳市镇柳黄路2188号
 TEL: 86-577-61758688 FAX: 86-577-62757002
 Http://www.aotero.com E-mail: aotero@aotero.com